


APPROVED
By Randy Trox at 10:14 am, Aug 28, 2009

1000 OR 1500 GALLON SEPTIC TANK
USED FOR PRE-TREATMENT AS PER
REQUIRED FLOW RATE CALCULATIONS

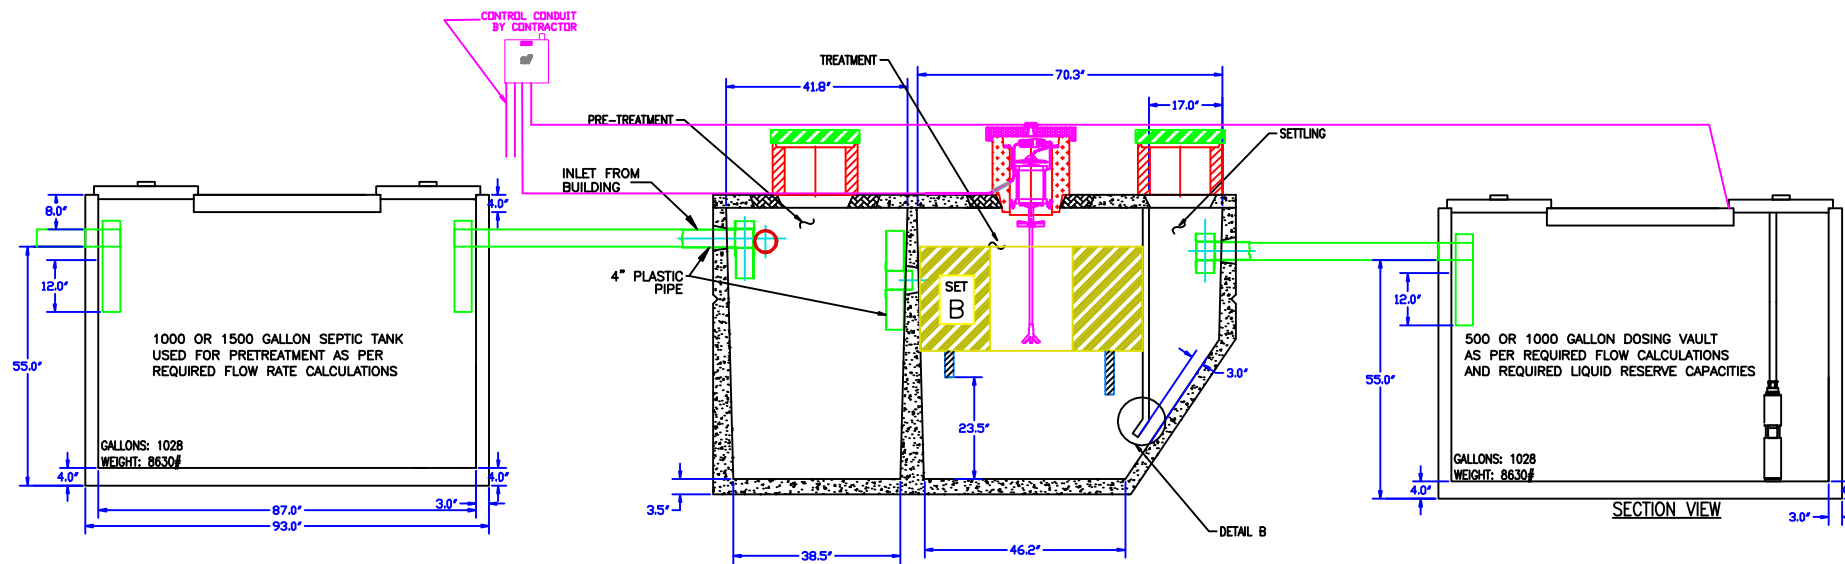


TANK AND LID ASSEMBLY

NOTES:

- 1.) AERATOR MODEL 700LL IN CONTINUOUS OPERATION MUST BE USED.
- 2.) IF AERATOR MOUNTING CASTING HAS NO RISER, RISERS ARE NOT REQUIRED HERE. REMOVABLE CONCRETE COVERS ARE REQUIRED.
- 3.) IF AERATOR MOUNTING CASTING HAS A RISER(S), COVERED RISERS ARE REQUIRED HERE. RISERS SHOULD BE DEVELOPED TO GRADE OR TO 6"-12" BELOW GRADE.
- 4.) THE SYSTEM SHOULD BE INSTALLED WITH A CONTROL PANEL THAT SHALL INCLUDE AN AERATOR WARNING LIGHT, HIGH WATER WARNING LIGHT, CIRCUIT BREAKER, CONTROL SWITCH, AUDIBLE ALERT, PUMP CIRCUIT ALARM TEST SWITCH, PUMP INTERLOCK, AND CIRCUIT BREAKER.
- 5.) THE SYSTEM MAY UTILIZE OREGON STATE APPROVED SEPTIC TANKS OR VAULTS FOR PRE-TREATMENT TANKS OR DOSING VAULTS.
- 6.) THE CONTROL PANEL MUST CONTAIN A FAILSAFE THAT WILL DISENGAGE THE PUMP IF THE AERATOR SHOULD MALFUNCTION.

I	N	G	F	E	D	C	B	A	REV.
									EN NO.
									DATE

	DRAWN BY:	DATE:
	SDZ	09/10/08
	APPROVED BY:	DATE:
	TML	09/10/08
	MATERIAL:	
	NONE	
	SCALE:	
	NTS	
	UNLESS OTHERWISE SPECIFIED: ALL DIMENSIONS IN INCHES DECIMAL: ± .005 FRACTION: ± 1/64 DEGREE: ± 1°	
TITLE:	1000 GALLON HOLDING WITH J-750 WITH 1000 GALLON PUMP TANK (OREGON)	
USED ON:	D	
EN NO.	Confidential and Proprietary Property of Jet, Inc. - No part of this drawing may be published, reproduced, copied, or used in any form, without the prior written permission of Jet, Inc.	
DATE	DRAWING NUMBER: 080910-1	