


**PLAN APPROVED**

Date 7/28/11 Signed DFW

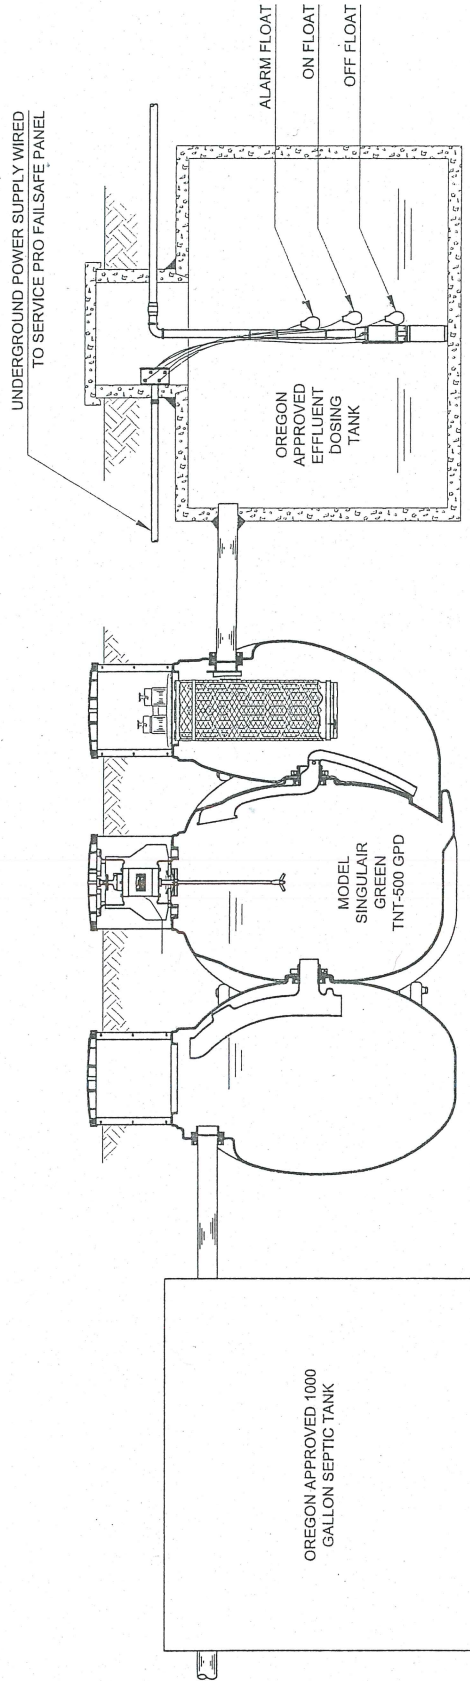

TREATMENT STANDARD #1 - PRESSURE DISTRIBUTION TO RECEIVING ENVIRONMENT

GENERAL NOTES:

1. FAILSAFE CONTROLS WILL SHUT DOWN EFFLUENT PUMP IF THERE IS A MALFUNCTION IN THE AERATOR OPERATION.
2. FAILSAFE CONTROLS WILL ALARM AND NOTIFY THE SERVICE PROVIDER IN THE EVENT OF A MALFUNCTION.
3. FAILSAFE CONTROLS WILL ALARM IF EFFLUENT LEVEL REACHES THE ALARM FLOAT.

PART NUMBER:	
REGISTRATION NUMBER	110001
DESIGN	VPE
APPROVED BY	JMM
DATE	4-13-11
SCALE	NTS
PROJECT NO.	PC-S-9982
<b>norweco</b>	
TREATMENT STANDARD #1 FLOW THROUGH SCHEMATICS	
U.S. AND FOREIGN PATENTS PENDING	
© MAXI	
MAXI WATER SYSTEMS, INC. 10000 W. 10TH AVENUE, SUITE 1000, DENVER, CO 80202	